



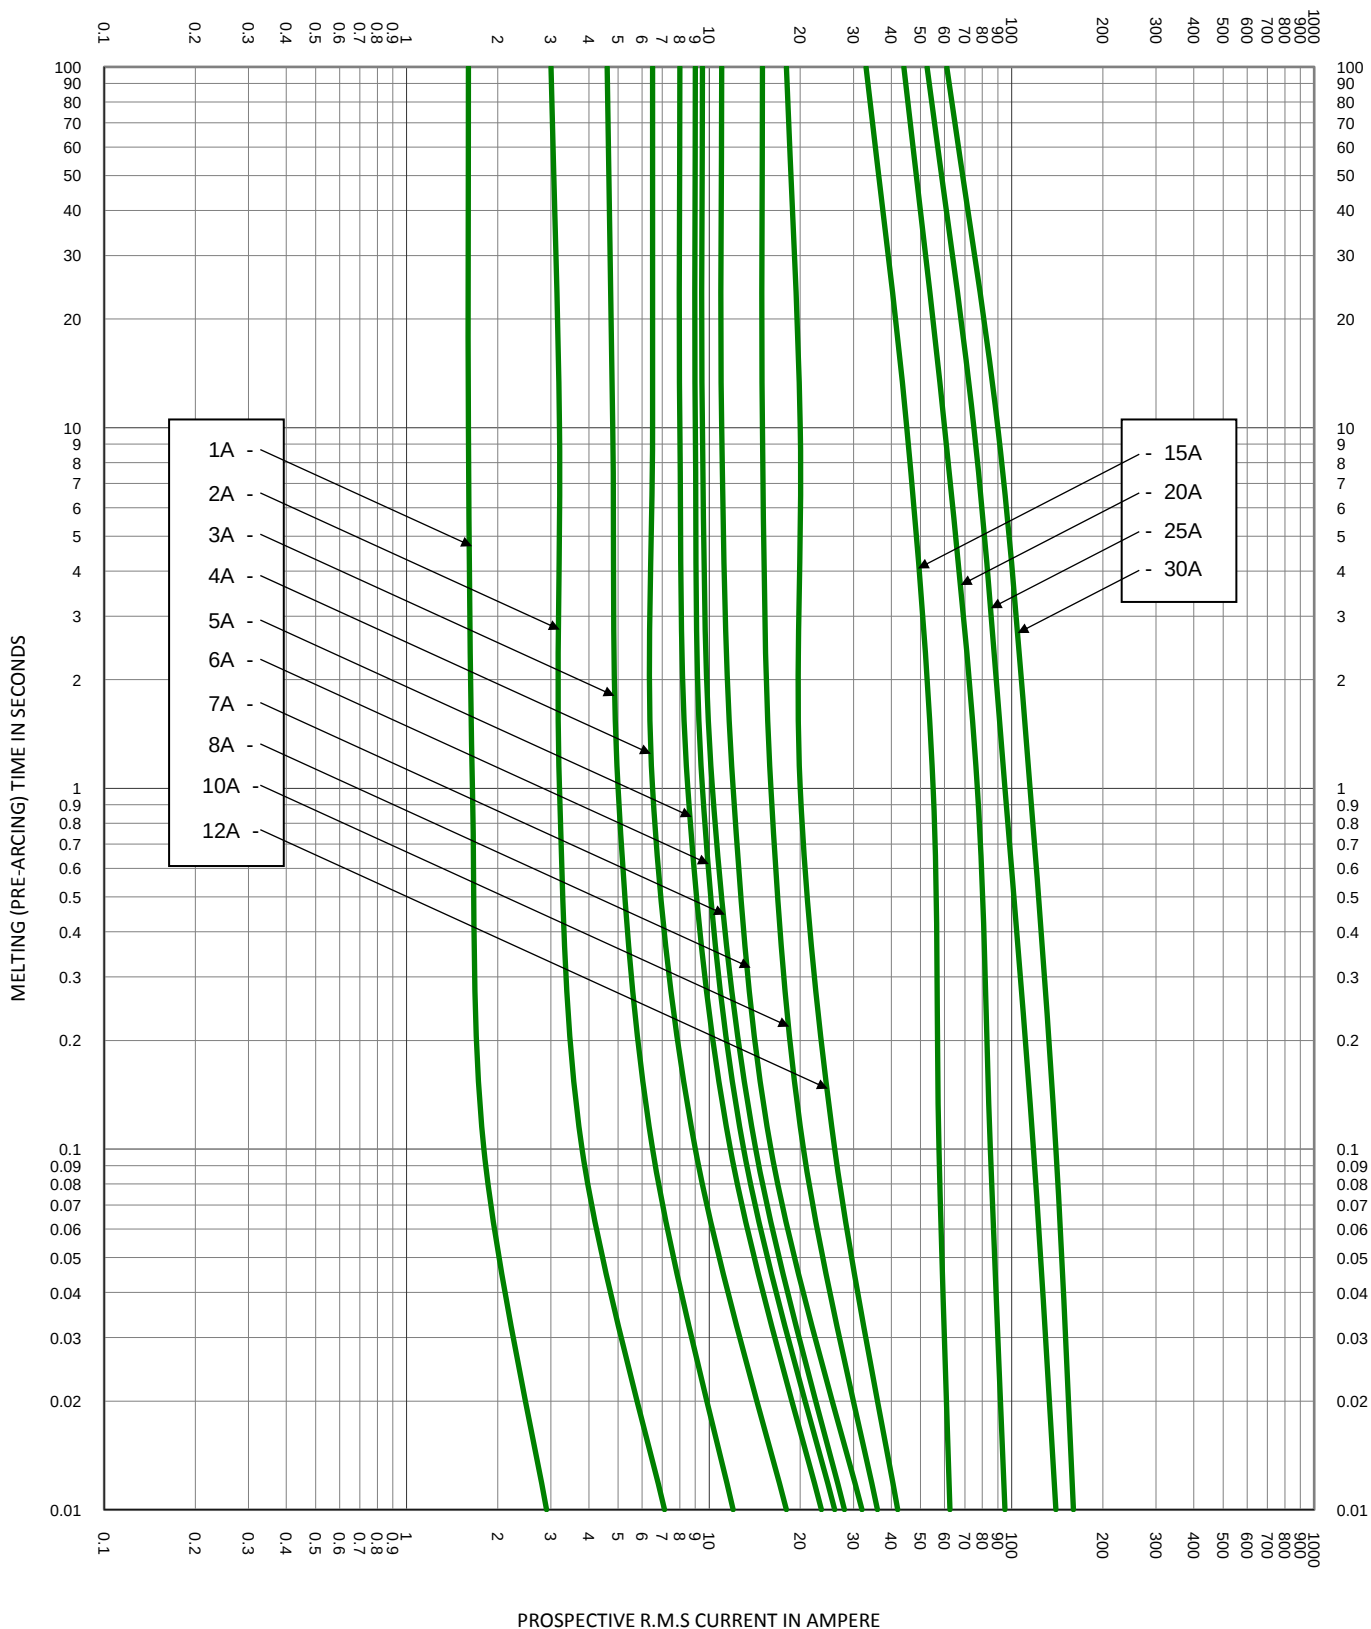


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L15S 1A - 1000A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 04/22/2016 REVISION: B
		DRAWING NO.: FCC01-L15S SHEET 2 OF 6


TIME CURRENT CHARACTERISTIC CURVES

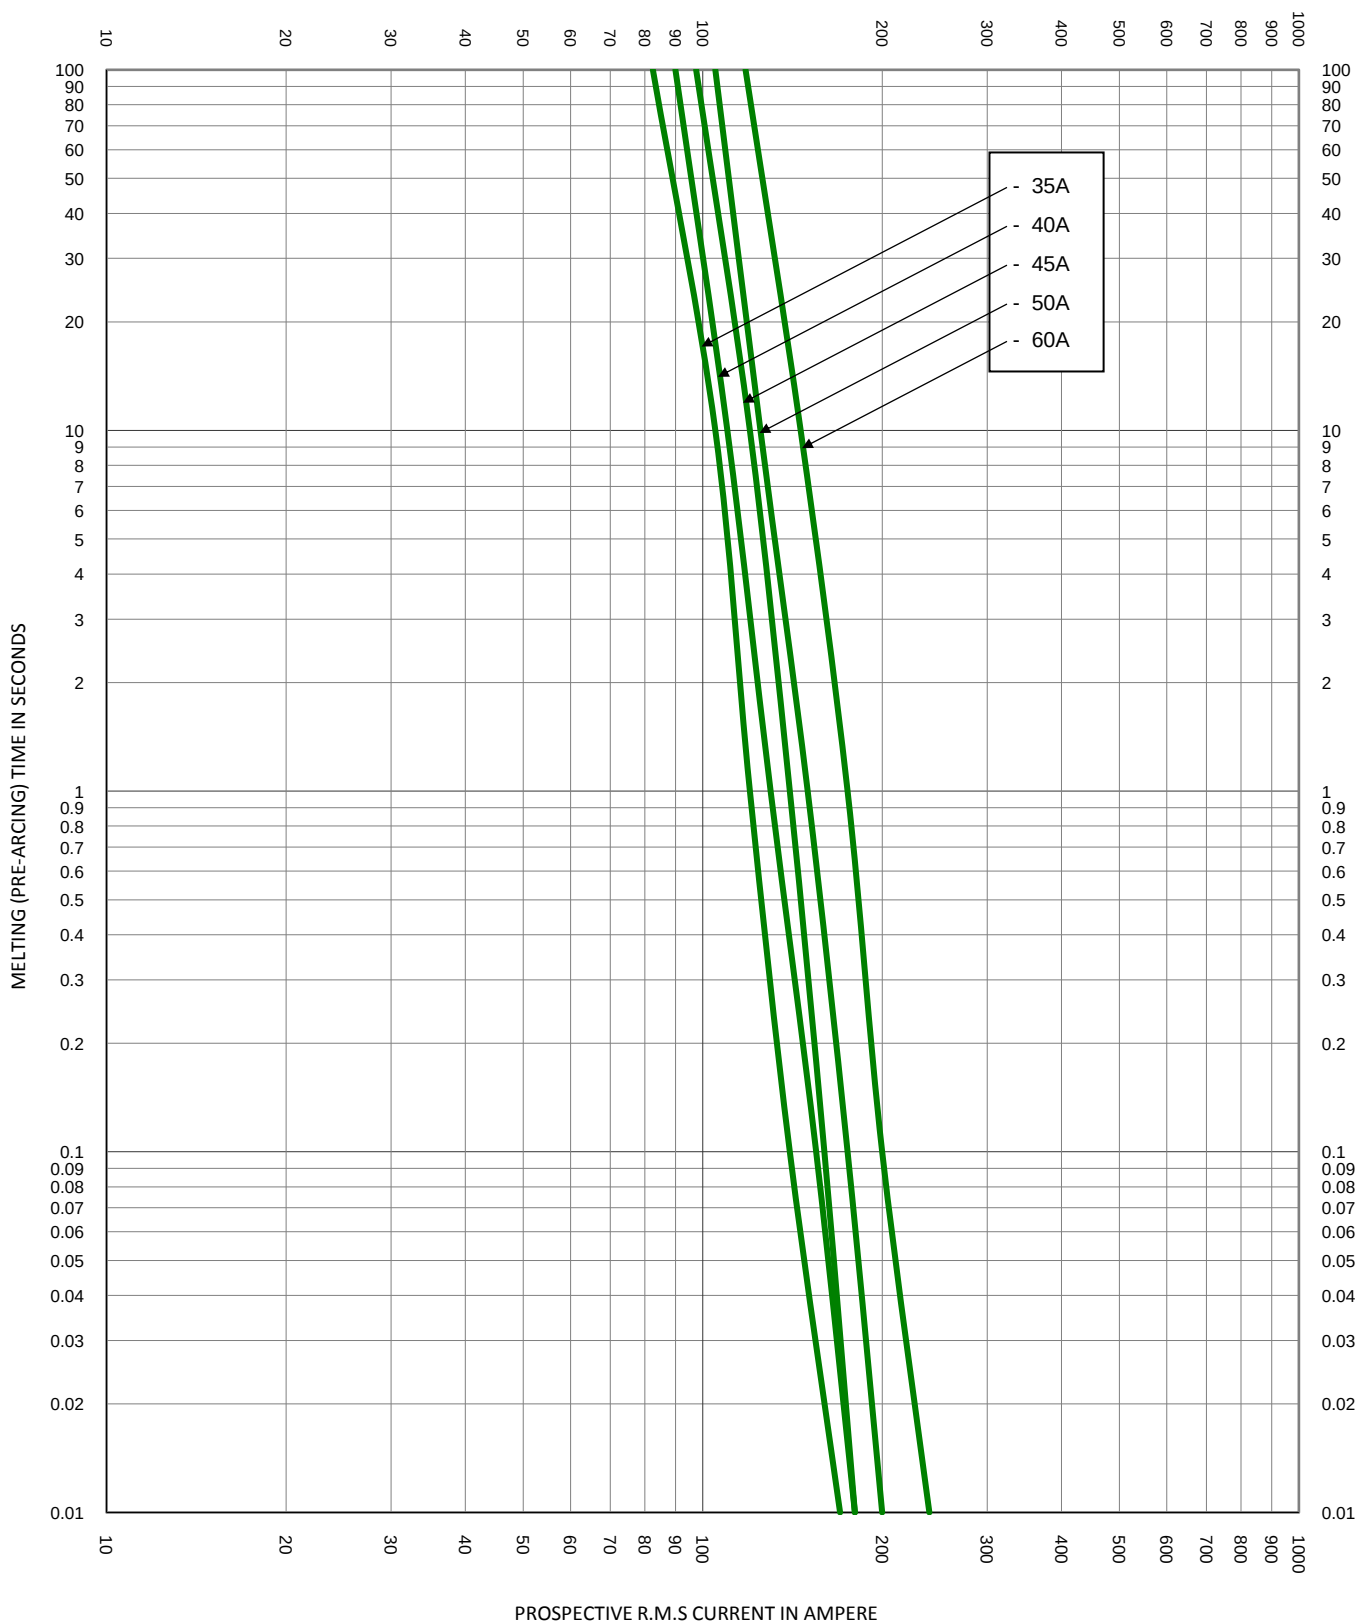

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:			L15S 1A - 1000A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 04/22/2016	
		REVISION: B	
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.:	SHEET 3 OF 6
		FCC01-L15S	

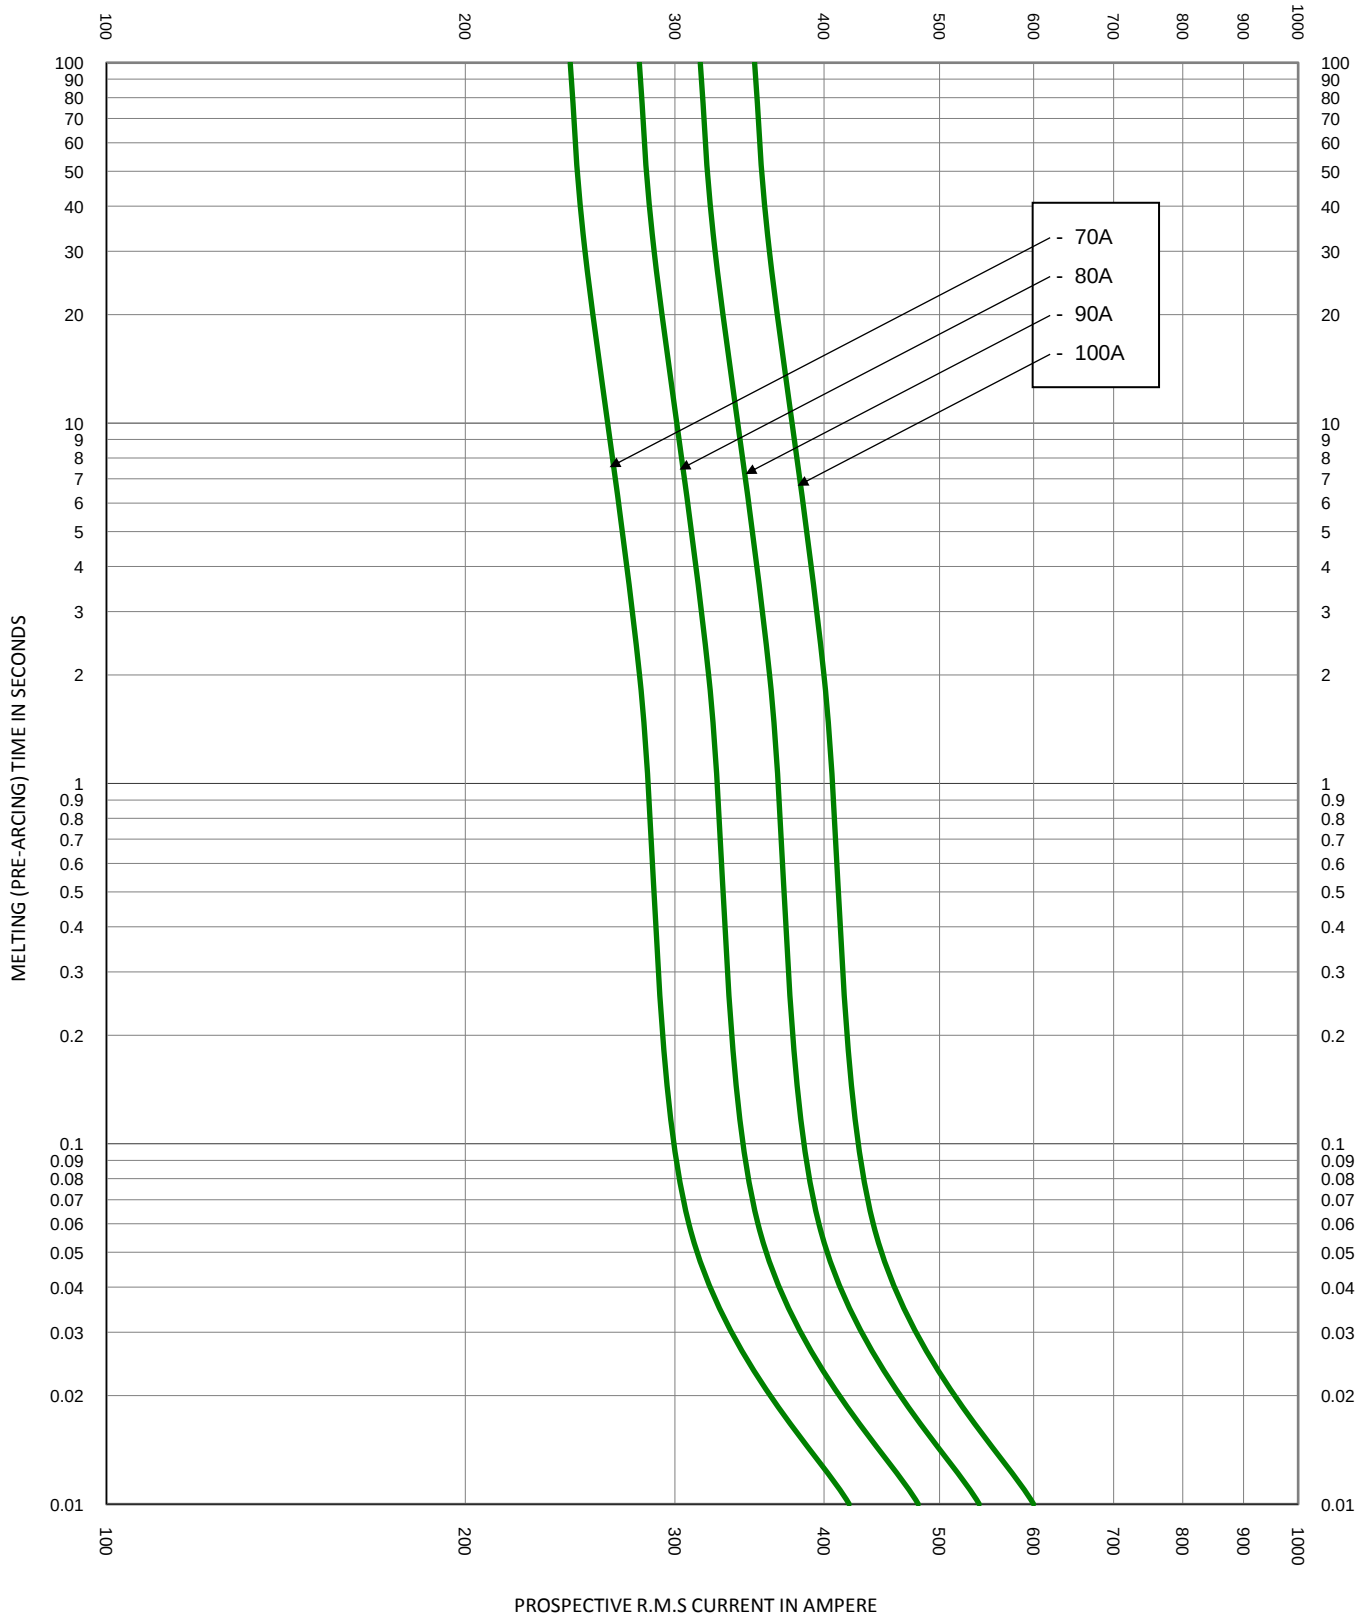


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L15S 1A - 1000A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 04/22/2016 REVISION: B
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-L15S SHEET 4 OF 6

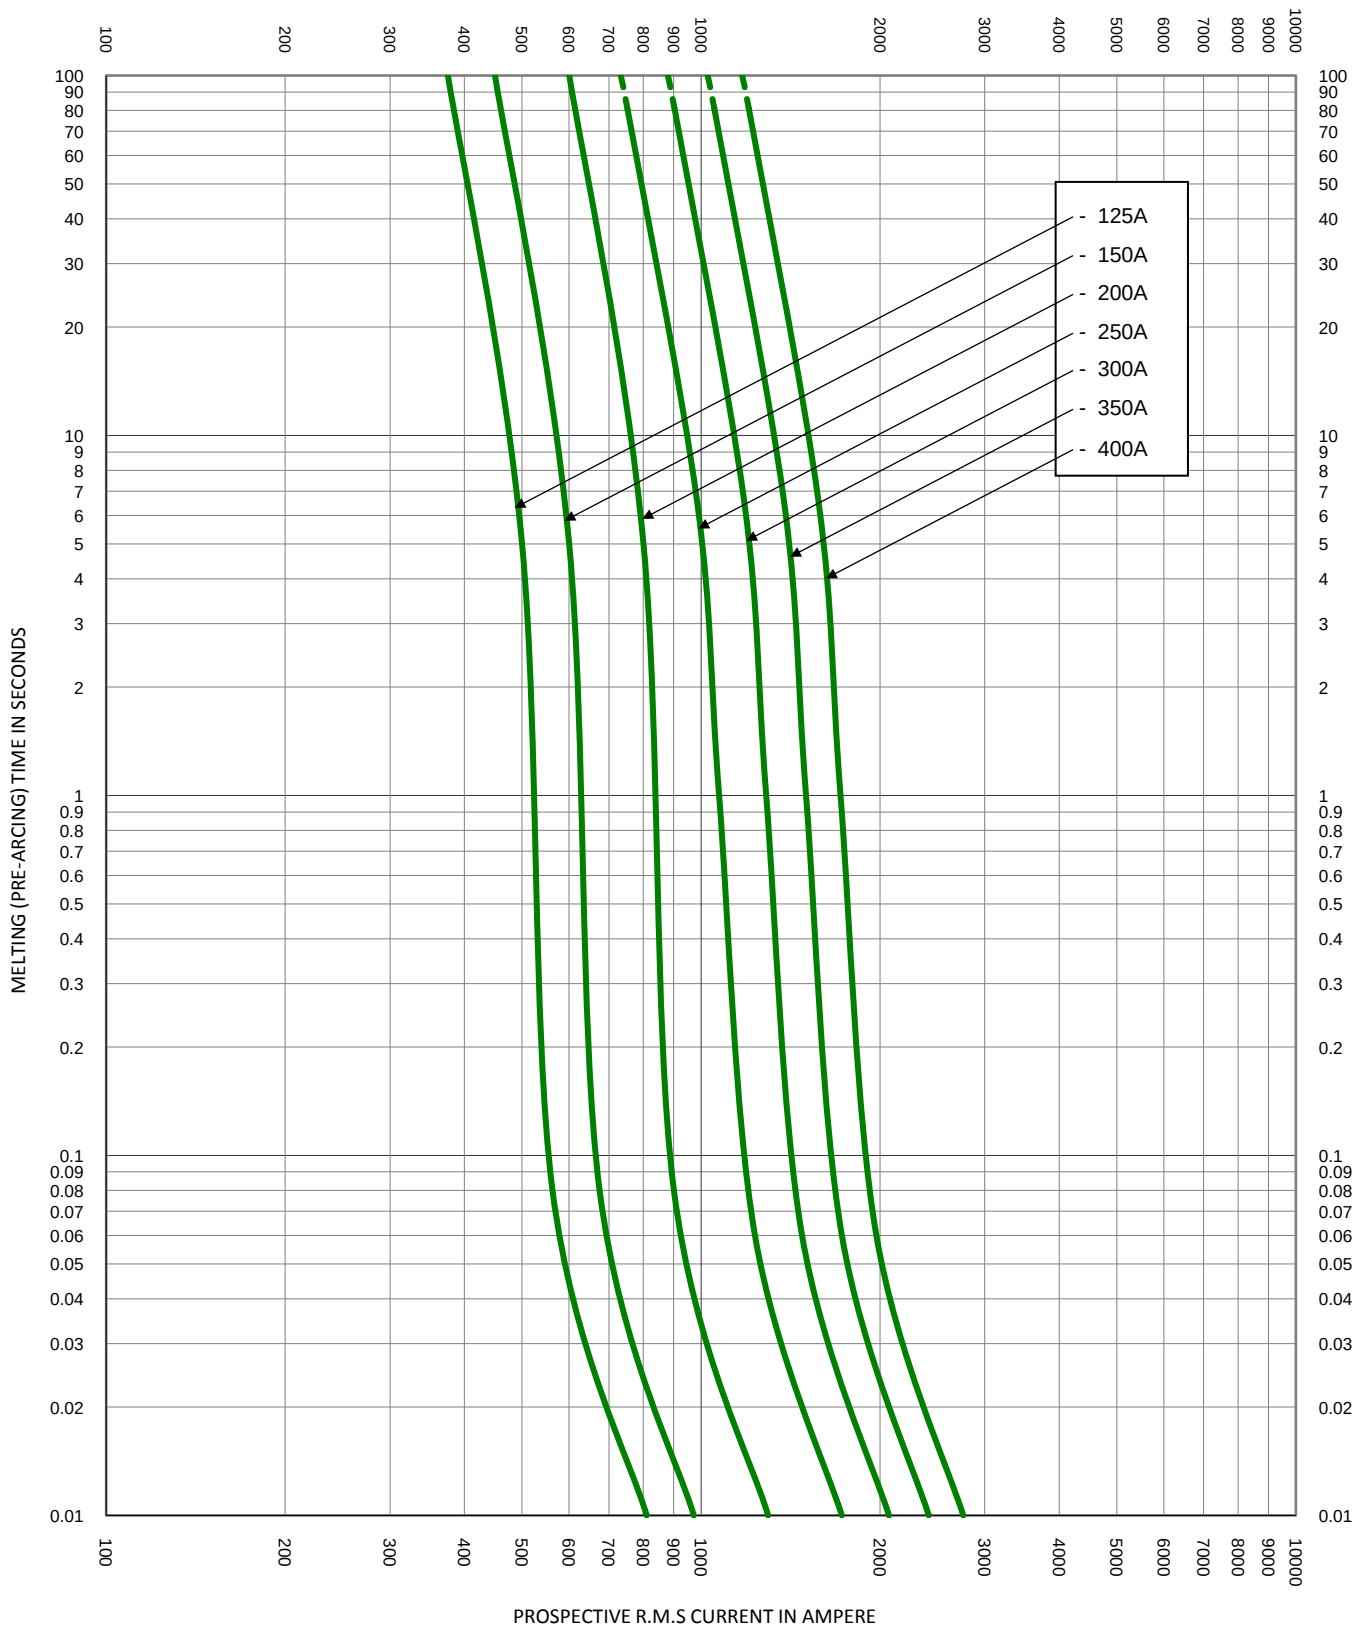

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L15S 1A - 1000A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 04/22/2016 REVISION: B
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-L15S SHEET 5 OF 6

TIME CURRENT CHARACTERISTIC CURVES

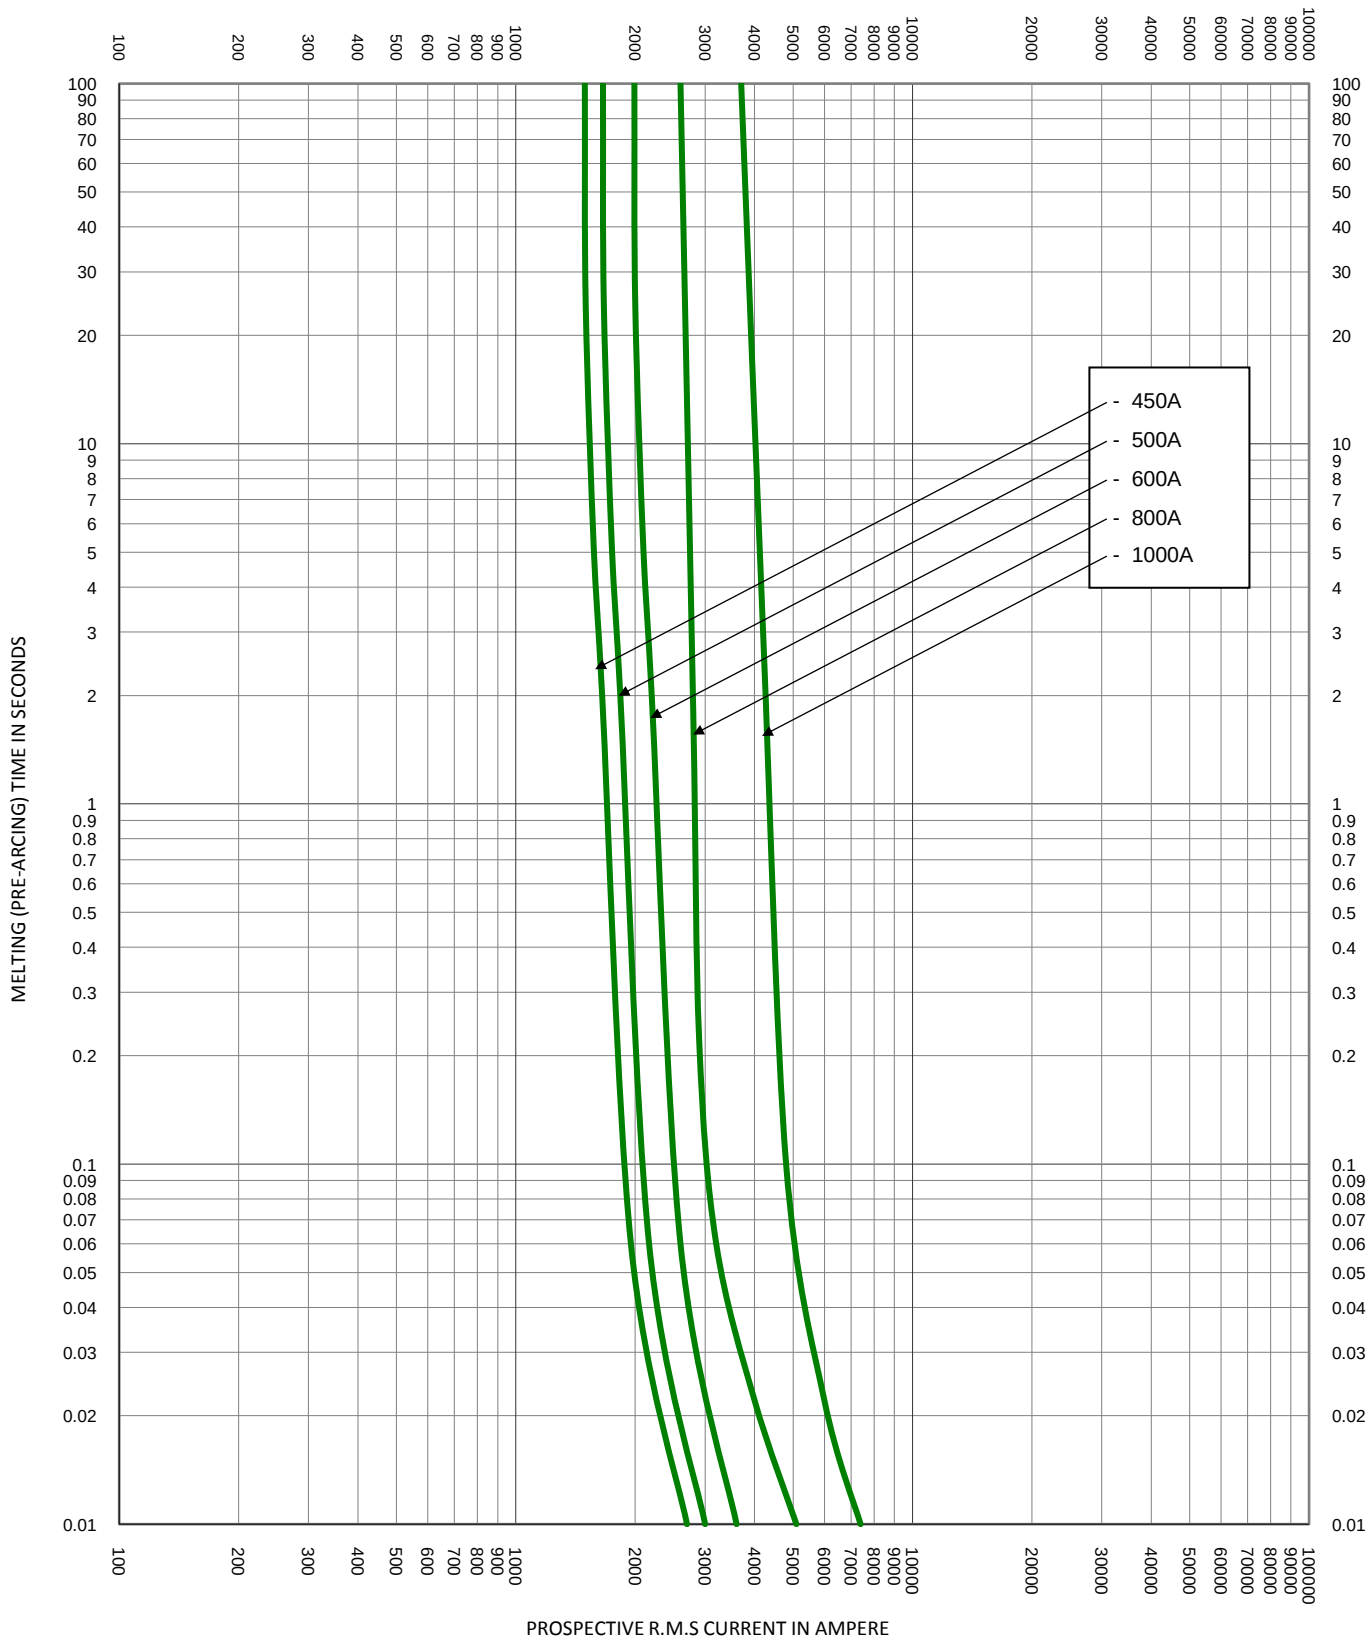

TEST VOLTAGE: BASIS FOR DATA:	TIME CONSTANT/POWER FACTOR: 	FUSE CATALOG NUMBER: L15S 1A - 1000A
LITTELFUSE, INC. CHICAGO, IL. USA TIME CURRENT CHARACTERISTIC CURVES		DRAWN BY: LLL DATE: 04/22/2016 REVISION: B DRAWING NO.: FCC01-L15S SHEET 6 OF 6